


MASO SINE PUMP SPS 2''

VISCOSITY: 1.000cp = 1.000 mPas
STATOR: POLYAMID NORMAL
LINER: POLYAMID NORMAL



performance-test

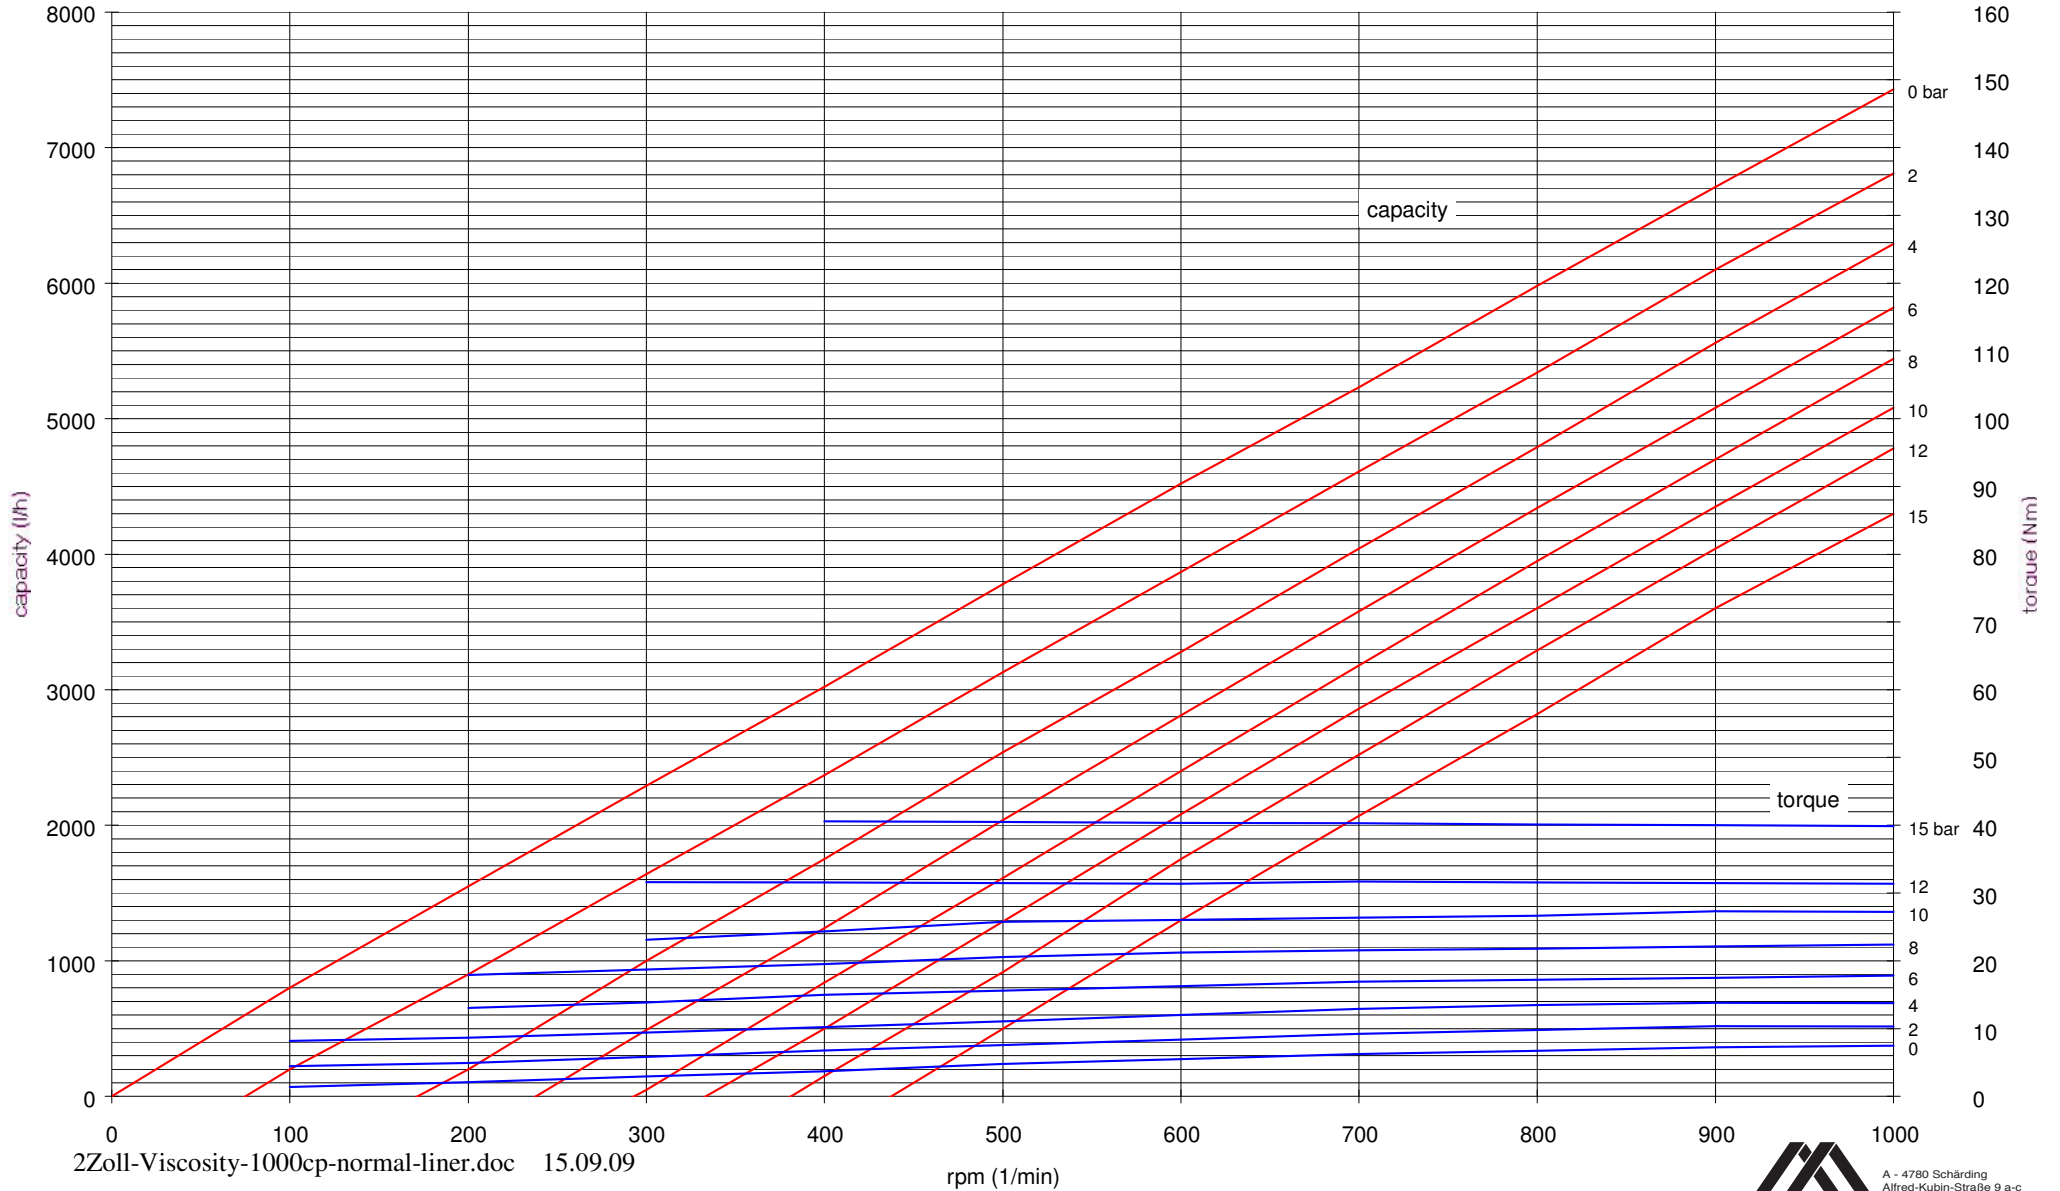

2Zoll-Viscosity-1000cp-normal-liner.doc 15.09.09